

Taluka Health Officer
Panchayat Samitee Mulshi(Paud)
Dist-Pune
No:-OWNO./HEALTH/WATER/ 143 /2026
Date:02/04/2026

ANNEXURE C
APPENDIX-VIII


PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

It is certified that an inspection team headed by Dr. VAMAN P. GENGAJE, TALUKA HEALTH OFFICER from TALUKA HEALTH OFFICE PANCHAYAT SAMITI, MULSHI (PAUD) inspected the "ORCHIDS THE INTERNATIONAL SCHOOL" Survey No.123, Vidya Valley School Road, Near Teerth Aarohi, Parkhe Vasti, Sus, Tal.Mulshi Dist.Pune Maharashtra on 02 April 2026 and on the basis of water test report bearing No.3134/2026 dated 30/03/2026 from State Public Health Laboratory, Pune.

It is certified that Orchids The International School, Sus has Safe drinking water facilities for Students and members of staff of the institution. School is also maintains hygienic and sanitation condition in the school building and the campus as per norms prescribed by the state government.

"The certificate is valid for the period from 02 April 2026 to 31 March 2027."

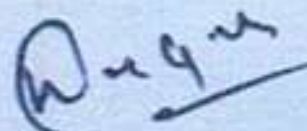



(Dr.VAMAN P.GENGAJE)

**TALUKA HEALTH OFFICER
PANCHAYAT SAMITEE MULSHI (PAUD)
TAL. MULSHI, DIST. PUNE**

TO,
PRINCIPAL,
ORCHIDS THE INTERNATIONAL SCHOOL,
SURVEY NO123, VIDYA VALLEY SCHOOL ROAD,
NEAR TEERTH AAROHI, PARKHE VASTI, SUS,
TAL. MULSHI, DIST. PUNE.


School Manager
ORCHIDS THE INTERNATIONAL SCHOOL
Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.

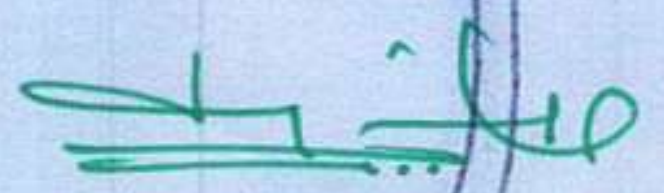
Principal
ORCHIDS THE INTERNATIONAL SCHOOL
Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.

					
STATE PUBLIC HEALTH LABORATORY, PUNE					
Dy Director tele No. 26330509 (P) Office Tele No. 26330225 (O)		Cantonment water works campus, Near Saint Mary Church, Staveley road, Pulgate, Pune-411 001 (MH) INDIA Email ID : sphlmis@gmail.com , statehealthlab@gmail.com website : arogya.maharashtra.gov.in			
HEALTH SERVICES:		No.SPHLPUNE/Desk-80/Bact.Section/water analysis report/ 3134 / 2026 Date : 30/03/ 2026			

Bacteriological Report of water Sample

Sender's Name	Orchids The International School, Susgaon, Pune.
Sender's letter No. & date	---/24-03-2026
Lab. Reference No.	209 / 948
Date of sample collection	24-03-2026
Date of sample received	24-03-2026
Analysis start date	24-03-2026

Sample Description		Bacteriological Analysis result			
		Most Probable Number of bacteria found per 100 ml of Water Sample			
		Coliforms	Thermotolerant Coliforms	E.coli	Conclusion
1.	Orchids The International School, Susgaon, Pune.	0	-	-	Potable


Remark: If water sample found non-potable, it can be used for drinking purposes after proper treatment and ascertaining its bacteriological quality for potability by retesting.

Note: Above sample/samples is/are not collected by this laboratory and result is/are as per submitted sample/samples.

Fee Rs. 340/-


Receipt No. : 7763374

Date : 24-03-2026

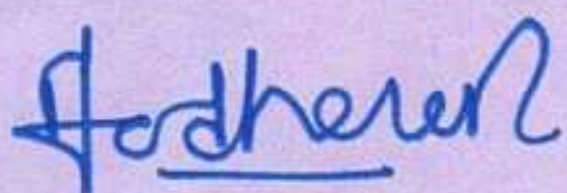


School Manager

ORCHIDS THE INTERNATIONAL SCHOOL
Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.

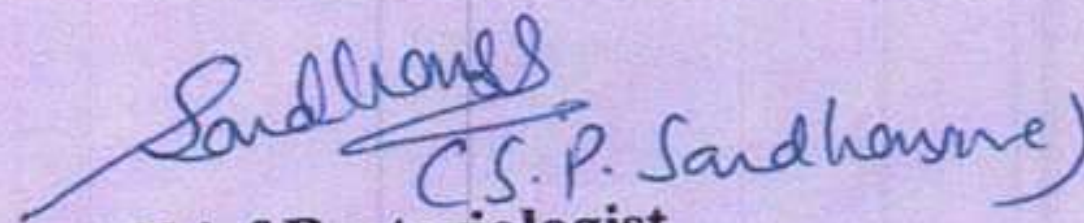
Chief Bacteriologist

State Public Health Laboratory, Pune

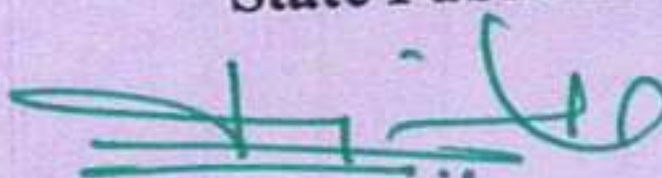

Principal

ORCHIDS THE INTERNATIONAL SCHOOL
Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.



GOVT. OF MAHARASHTRA

DEPUTY DIRECTOR, HEALTH SERVICES
STATE PUBLIC HEALTH LABORATORY, PUNE.
Near St. Mary School And Church, Pune 411001

Telephone - Office :- (020) 263300225 Ext. 223

Email : statehealthlab@gmail.com



HEALTH SERVICES

NO.:- SPHL PUNE /Desk -79 / 152 / 2026. DATE :- 06/05/2026.



TC-11706

Report on Chemical Analysis of Water

Sent by :- Orchids the international School ,Sus gaon Pune.

Dated :- 24/03/2026

With Ref. letter No :- ---

Date of Collection :- ----

Date of Receipt :- 24-03-2026

Date of Examination :- 25/ 03/ 2026 Onwards

(All the Analytical Results are in mg. / Lit. except pH , Turbidity .

Parameters under Scope

SR. NO	TEST PARAMETER	S.No -1 (P-186) Filter Water	Test Method	BIS Specifications 10500 : 2012 Normal Values	
				Desirable limit	Permissible limit
1	pH Value	7.15	FSSAI, Manual of methods Of Analysis of Water With 2016.	6.5 to 8.5	No relaxation
2	Chlorides (as Cl)	13.70	FSSAI, Manual of methods Of Analysis of Water With 2016.	250	1000
3	Total Hardness (as Caco3)	44.81	FSSAI, Manual of methods Of Analysis of Water With 2016.	200	600
4	Alkalinity (as Caco3)	32.52	FSSAI, Manual of methods Of Analysis of Water With 2016.	200	600

School Manager

ORCHIDS THE INTERNATIONAL SCHOOL

Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.

Principal

ORCHIDS THE INTERNATIONAL SCHOOL

Survey No.123, Vidya Valley School Road,
Near Teerth Aarohi, Parkhe Vasti, Sus-411021.